

Professional Certification
I, **JAMES POSEY**, hereby certify that the calculations and drawings were prepared or approved by me, and that I am a duly licensed professional engineer in the State of Maryland. My license number is 14894, and its expiration date is 06/01/2011.

PROFESSIONAL SEAL:
JAMES POSEY
Professional Engineer
No. 14894
State of Maryland
Exp. 06/01/2011


COM. NO.: 5428-06
PRINTS ISSUED

NO.	DESCRIPTION	DATE
1.	BID DOCUMENTS	1/29/10

CALVERT
HIGH SCHOOL
REPLACEMENT
FACILITY



CALVERT COUNTY
PUBLIC SCHOOLS
SHEET TITLE
FLOOR PLANS
PHASE 1 - FIRE PROTECTION
NEW WORK

PROJECT NO.
07021
DATE
1/28/10
SCALE
1/16" = 1'-0"
SHEET NO.
FP2.02

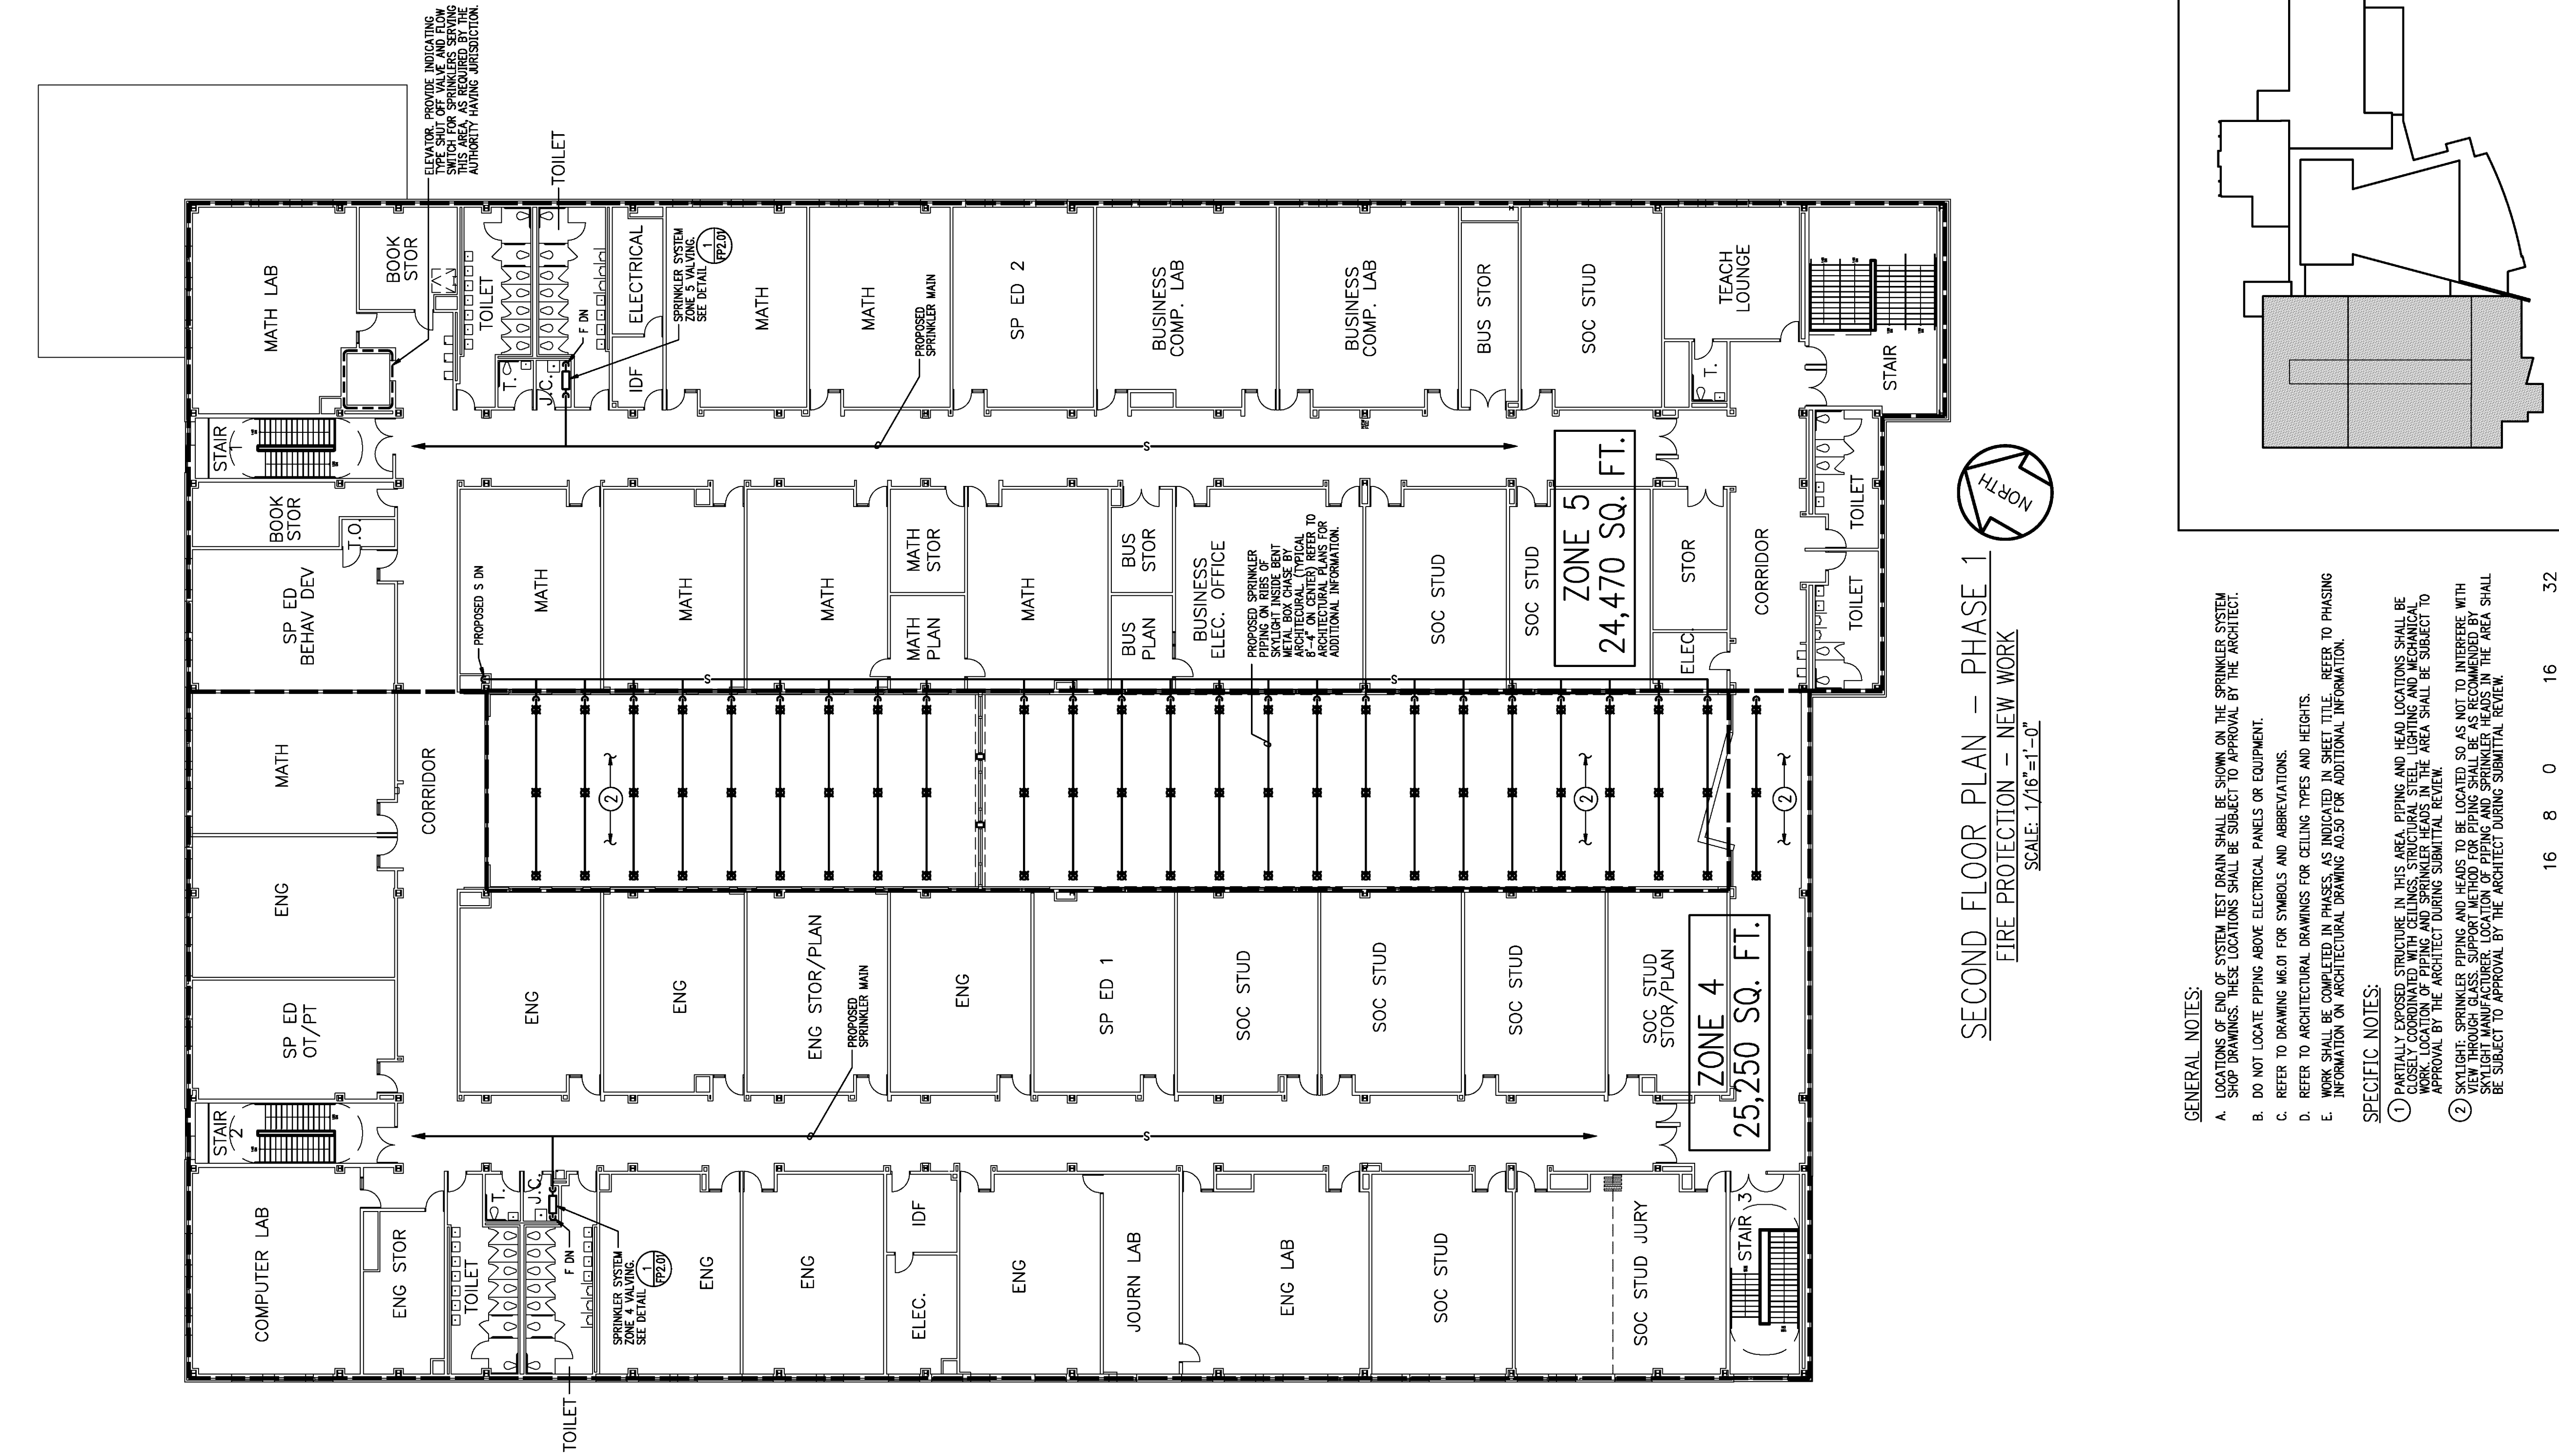

SECOND FLOOR PLAN - PHASE 1
FIRE PROTECTION - NEW WORK
SCALE: 1/16"=1'-0"

- GENERAL NOTES:
- LOCATIONS OF FIRE ALARM TEST BELL SHALL BE SHOWN ON THE SPRINKLER SCHEDULE DRAWINGS. THESE LOCATIONS SHALL BE SUBJECT TO APPROVAL BY THE ARCHITECT.
 - DO NOT LOCATE PIPING ABOVE ELECTRICAL PANELS OR EQUIPMENT.
 - REFER TO DRAWING SET FOR SYMBOLS AND ABBREVIATIONS.
 - REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES AND HEIGHTS.
 - REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
- SPECIFIC NOTES:
- PARTIALLY EXPOSED STRUCTURE IN THIS AREA. PIPING AND HEAD LOCATIONS SHALL BE APPROVED BY THE ARCHITECT DURING SUBMITTAL REVIEW.
 - SKYLIGHT: SPRINKLER PIPING AND HEADS TO BE LOCATED SO AS NOT TO INTERFERE WITH SKYLIGHT MANUFACTURER'S LOCATION OF PIPING AND SPRINKLER HEADS IN THE AREA SHALL BE SUBJECT TO APPROVAL BY THE ARCHITECT DURING SUBMITTAL REVIEW.

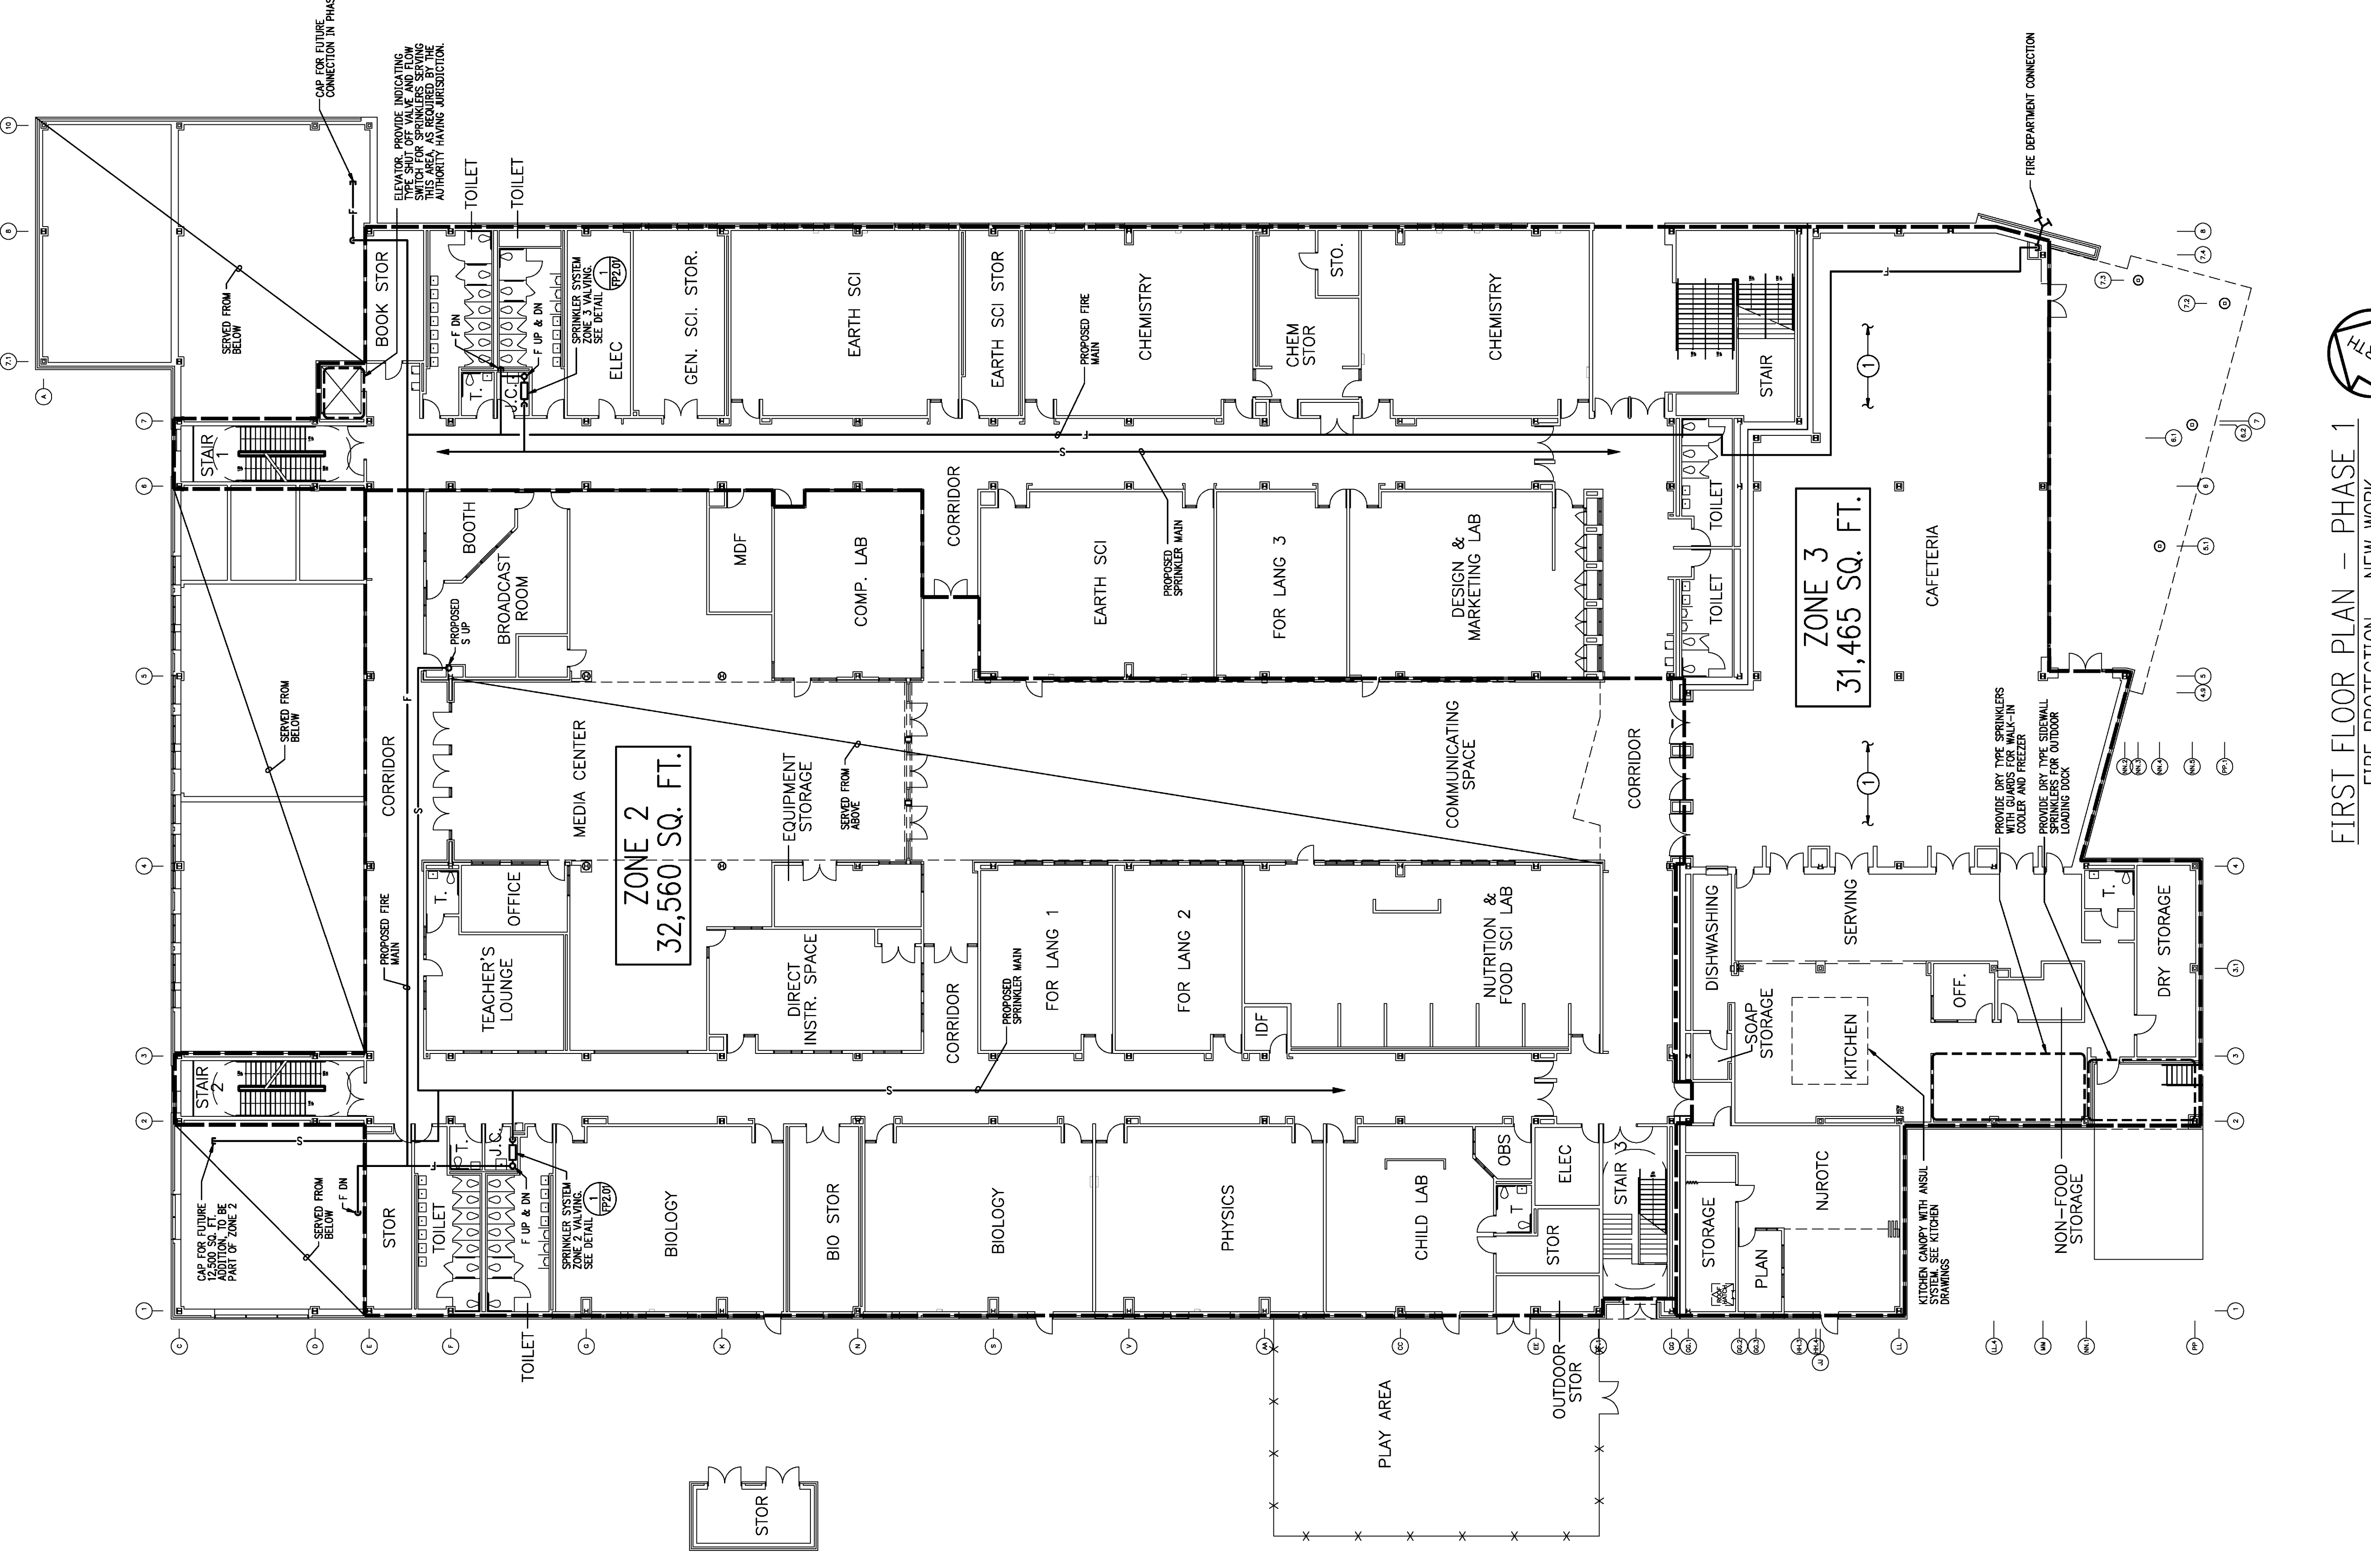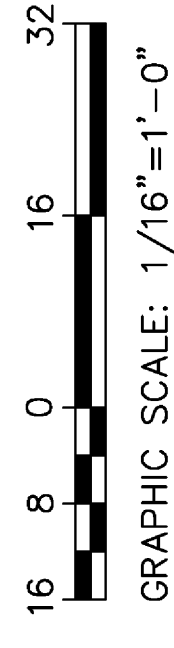

FIRST FLOOR PLAN - PHASE 1
FIRE PROTECTION - NEW WORK
SCALE: 1/16"=1'-0"

